

PLAN

NOTES:

BRICK MASONRY CAN BE COMMON CLAY BRICK, JUMBO BRICK, OR CONCRETE BRICK.


CONCRETE BOTTOMS SHALL BE PAID AS BRICK MASONRY.

ALL MORTAR JOINTS ARE TO BE 1/2" ± 1/8".

FOR DEPTHS OVER 3'-6" USE STEPS ON 16" CENTERS. STEPS SHALL BE IN ACCORDANCE WITH COG STD. #414.

FOR PRECAST CONCRETE MODELS OF THIS STRUCTURE, THE MANUFACTURER SHALL STAMP OR STENCIL ITS LOGO OR NAME ON THE INSIDE AND OUTSIDE OF THE STRUCTURE.

COG STD. #406 OR #407
GRATE & FRAME

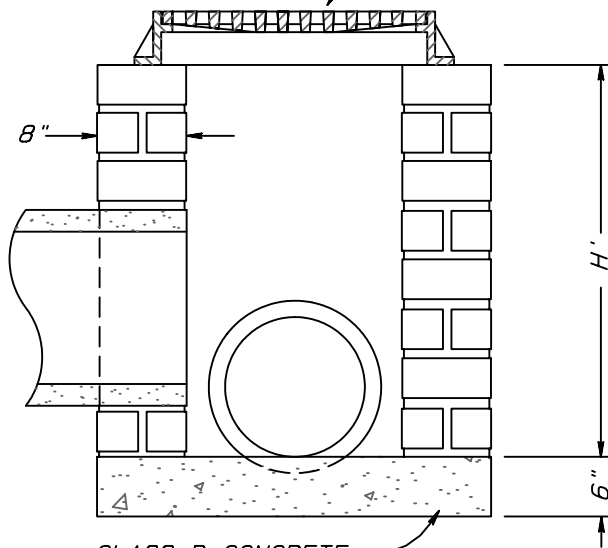

CLASS B CONCRETE,
2500 PSI

SECTION A-A

QUANTITIES	
BASE (C. Y.)	H' (PER FT. HEIGHT)
0.198	0.256

DEDUCTIONS FOR ONE PIPE		
PIPE SIZE	C.M.	R.C.
12"	0.020	0.032
15"	0.031	0.047
18"	0.044	0.065

CITY OF GREENSBORO

**STANDARD BRICK MASONRY DROP
INLET FOR 24" x 24" GRATE**

STD. NO.	REV.
410	09-95
	08-02
	12-07